




JAS-ANZ



JAGDAMBA LABORATORIES

(A Govt. Approved Test House) *

181, Padmavati Colony (B), New Sanganer Road,
Post-Shyam Nagar, Jaipur - 302 019 Tel. : 0141-2390604
E-mail : jagdamba_lab@yahoo.com
Web. : www.jagdambalab.com



An ISO 9001 : 2000 Certified Lab.

License No. Raj. : 2124, Date : 26.06.2002
(Form 39, Rule 150-E (f) Report of Test of Analysis By Approved Institution)

CERTIFICATE OF ANALYSIS

Sample : NEEM BASED ORGANIC MANURE Report No. R-102/2009

Manufactured by M/s. : UPRISE LAMINATORS ,(P) LTD. 4 -A JHOTWARA IND. AREA JAIPUR Recd. Dt. 04/04/2009

Supplied by M/s. : UPRISE LAMINATORS ,(P) LTD. 4 -A JHOTWARA IND. AREA JAIPUR Ref. No. 090


Batch No. N.S. D/M N.S D/E N.S. Batch Size N.S. Sample Qty. 500 gm

Mfg. Lic. No. _____

RESULT OF ANALYSIS :

Description ; - Black colour granular powder.

<u>PARAMETER</u>	<u>FOUND</u>
pH	: -7.13
Nitrogen (as N)	: - 3.41%
Phospours (as P)	: - 0.836%
Potassium (as K)	: - 1.34%
Calcium (as Ca)	: - 4.77%
Magnesium (as Mg)	: - 0.751%
Magnese (as Mn)	: - 261ppm
Iron (as Fe)	: - 927ppm
Copper (as Cu)	: - 68ppm

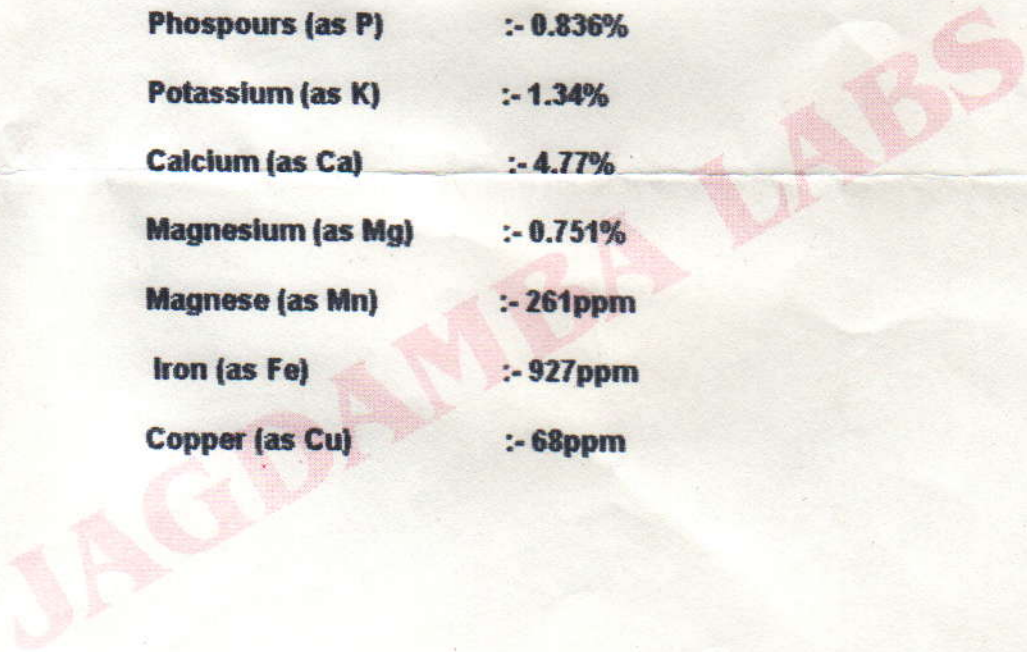

REPORT : In the opinion of the undersigned the sample referred to above IS OF STANDARD QUALITY /IS NOT OF STANDARD QUALITY as defined in the Act and Rules made there under for the purpose of analysis.

08/04/2009